



SUBMITTAL DATA - INDOOR UNIT **VEHW009N432U2** **VRF WALL MOUNTED TYPE EVAPORATOR**

Job Name: _____
 Location: _____
 Schedule No.: _____
 System Designation: _____

Engineer: _____
 Architect: _____
 Date: _____
 For: _____ Reference _____ Approval _____ Review _____ Construction _____

FEATURES

- Auto Addressing installation
- Auto Restart
- Auto Swing Louvers
- Built-in Electronic Expansion Valve
- LED Display
- Washable Filter
- Mildew-proof Filter
- Anti-Freezing Protection
- Enameled finish

PRODUCT WARRANTY

All covered components - Five year limited warranty

SPECIFICATIONS

PERFORMANCE

Cooling Capacity* (Btu/h)		9,554
Heating Capacity* (Btu/h)		10,918
Airflow (CFM)	High	294
	Medium	259
	Low	177

Sound Pressure Level (dBA) H / M / L 35/33/30


ELECTRICAL DATA

Power Supply (V / Hz / Ph)	208-230/60/1 - 220-240/50/1
MOCB (A)	6
Rated Current Input (A)	Cooling 0.2
	Heating 0.2

DIMENSIONS

Unit Dimensions (in)	Height	11 3/8
	Width	33 1/4
	Depth	8 1/4

Liquid Pipe Connection (in)	1/4
Gas Pipe Connection (in)	3/8
Shipping Weight (lb)	27.5
Net Weight (lb)	23.2

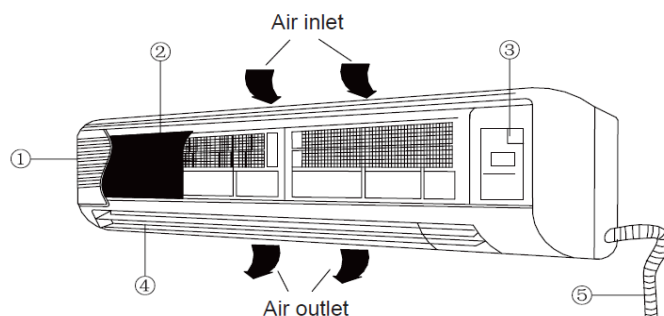

1. Surface Panel
2. Air Filters
3. Electronic Box Cover
4. Swing Louvers
5. Drain Hose

NOTES:

*Cooling and Heating Capacity data is rated at the following conditions:

Cooling: 80 °F DB / 67 °F WB Indoor, 95 °F DB Outdoor


Heating: 70 °F DB Indoor, 47 °F DB

NOTE – Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. ©2022 Lennox Industries Inc.



SUBMITTAL DATA - INDOOR UNIT
VEHW009N432U2
VRF WALL MOUNTED TYPE EVAPORATOR

DIMENSIONAL DRAWINGS

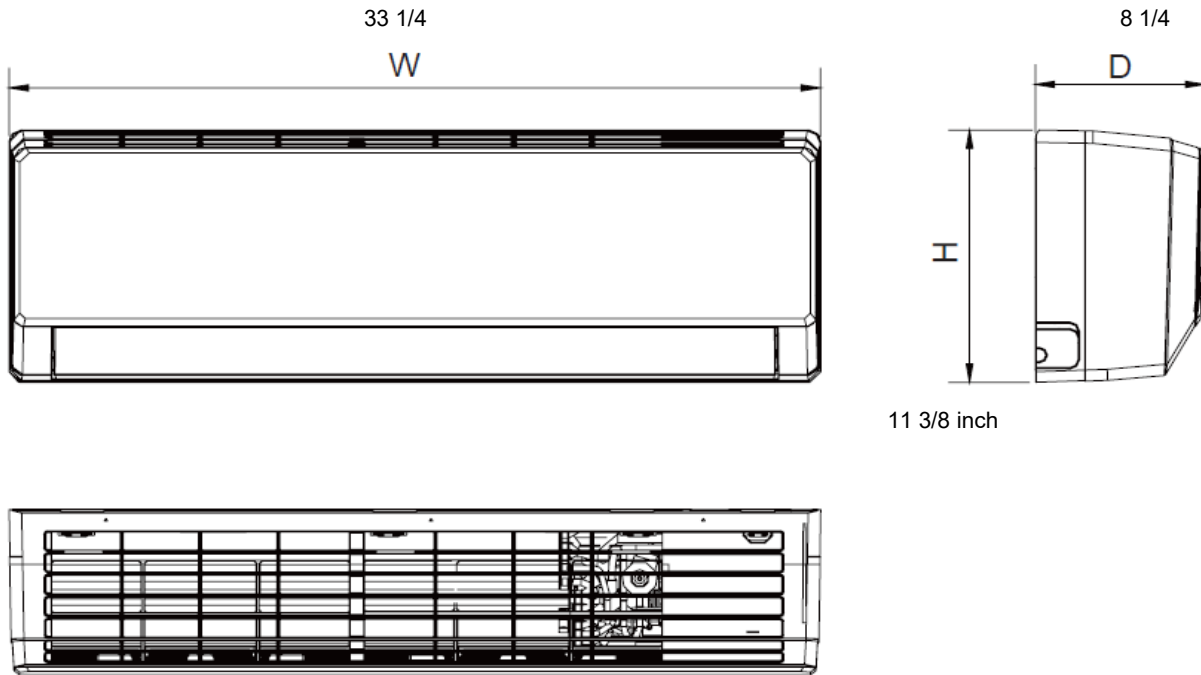

NOTE – Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. ©2022 Lennox Industries Inc.

Submittal Rev-B-05-2022